

CERTIFICATE

No. 000045/05

In accordance with the **CertAlarm** Rules
and Certification System 5, as defined in ISO / IEC Guide 67,
we Telefication B.V. certify that the product

ATS4601E

is in conformity with the following standard(s)

EN 50131-3: 2009
Control and indicating equipment

EN 50131-6: 2008
Power supply equipment

EN 50136-1-1: 1998 + A1
General requirements for alarm transmission equipment

EN 50136-2-1: 1998 + A1
General requirements for alarm transmission equipment

UTC Fire & Security B.V.


Kelvinstraat 7
6003 DH Weert
Netherlands

is authorised to use the CERTALARM Mark on the above mentioned product.

This certificate is valid until:

06 July 2016

Signed on behalf of Telefication B.V.
17 April 2014



W.J.M. Jong
Manager Product Certification
www.certalarm.org



Telefication B.V.

Edisonstraat 12A
6902 PK Zevenaar
Phone : +31 316 583 180
Fax : +31 316 583 189
E-mail: certification@telefication.com
Web: www.telefication.com

CERTIFICATE

No: 000045/05 - Annex No 1

Takes into account the following product and variants:

- Product description: Intrusion Control Panel
- Trademark: Interlogix
- Family name: ATS range
- Type Designation: ATS4601E
- Hardware version: 1055451
- Software version: 04.11.06

- Product description: Intrusion Control Panel
- Trademark: Interlogix
- Family name: ATS range
- Type Designation: ATS46xxE
- Hardware version: 1055451
- Software version: 04.11.06

The optional features of the specifications that are included in the product and test report:

Equipment Security 2 or 3 dependenden on software setting.

Equipment Environmental Class: II

Equipment Class: Fixed

According to EN 50131-1:2006 and A1:2009, this equipment can be applied in installed systems up to and including Security Grade 2 or 3 dependent on software setting.

The ATS46xxE control panel should be furnished with the metal housing ATS1642.

The "xx" in type designation ATS46xxE stands for different country/language codes.

The onboard PSTN communicators can only be used in Security Grade 2.

Performance criteria:

ATS 2: D2, M2, T2, S0, I0

Telefication B.V.

Edisonstraat 12A

6902 PK Zevenaar

Phone : +31 316 583 180


Fax : +31 316 583 189

E-mail: certification@telefication.com

Web: www.telefication.com

Test Report Numbers:

- VdS GmbH: STE 04/0425, 07 June 2006
- Telefication B.V.: 20103678200rev6.0, 12 March 2014
- Telefication B.V.: 20103678800rev4.0, 13 November 2013
- Telefication B.V.: 20133985800rev1.0, 12 December 2013
- Telefication B.V.: 20123698800rev1.0, 22 November 2012

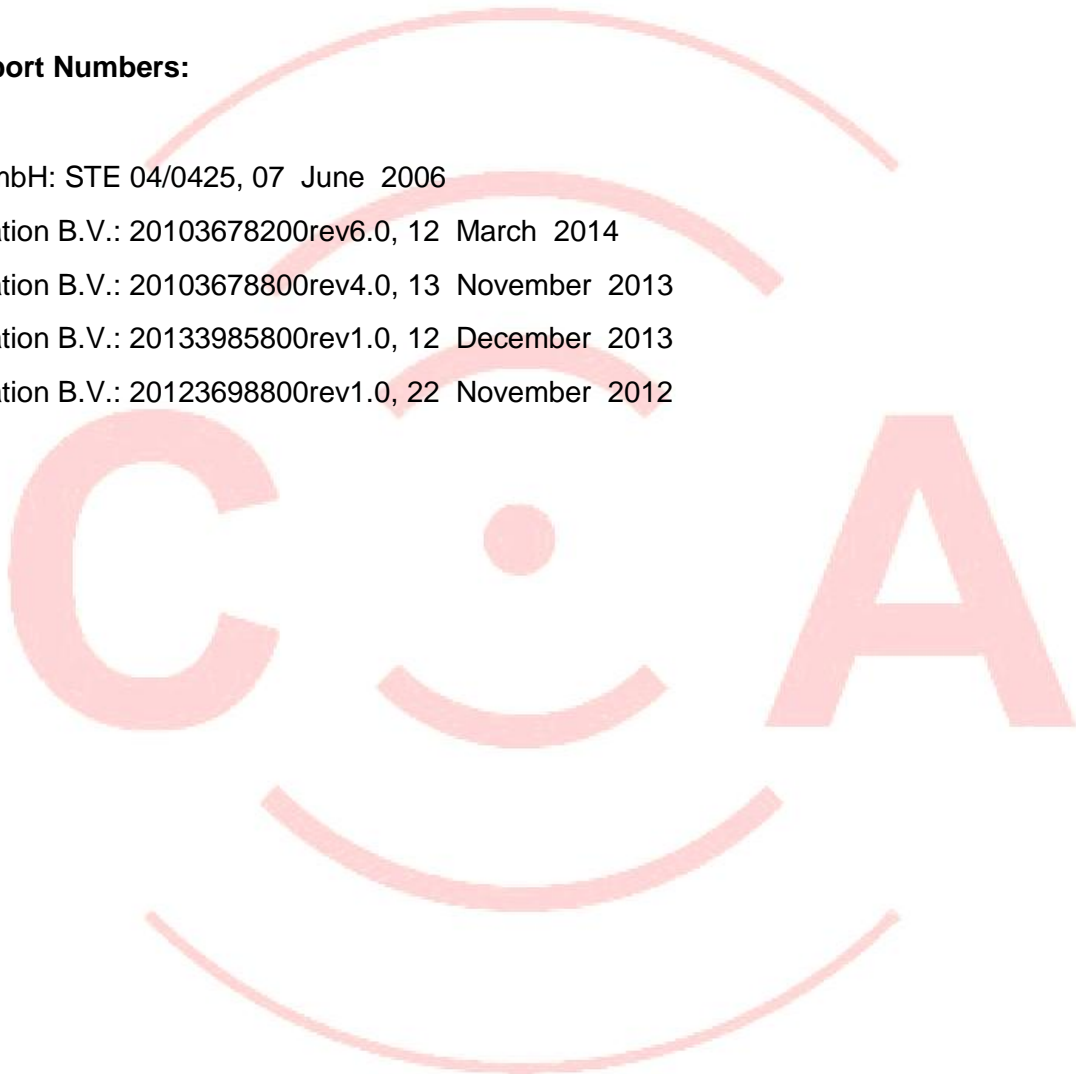

Telefication B.V.

Edisonstraat 12A
6902 PK Zevenaar
Phone : +31 316 583 180
Fax : +31 316 583 189
E-mail: certification@telefication.com
Web: www.telefication.com

CERTIFICATE

No: 000045/05 - Annex No 2

Validity of Certificate:

The Certificate remains valid based upon satisfactory annual factory production control audits for Fire products or biennial factory production control audits for Security products and follow up re-testing as required by CertAlarm scheme rules.

Documents submitted:

- Assembly drawings
- Bill of materials
- Electric diagrams
- Photos
- User manual

DISCLAIMER

The validity of this certificate is limited to products, which are equal to the one(s) examined.